



4-20 mA to Modbus TCP Isolated
Tel: +1 561 779 5660 - e-mail: datexel@datexel.com- www.datexel.com

FEATURES

- Interface Ethernet 10/100 Base-T, Modbus TCP Server
- 4 isolated input channels
- Analogue inputs for mA and Volt
- Isolated power source for each channel to power passive sensors
- Integrated web server to acquire the status of the analogue inputs via browser
- Remotely programmable
- Connection by removable screw-terminals
- LED signalling for Link/Act Ethernet, power supply
- Galvanic isolation on all the ways
- CE mark
- In compliance to EN-50022 DIN rail mounting

GENERAL DESCRIPTION

The device DAT8015 is a Modbus TCP server unit that can convert up to 8 analogue signals applied to the input in engineering units in digital format. The inputs can be connected to sensors with current or voltage output. The input channels are electrically isolated from each other.

For each input channel it is provided an isolated power source in order to power passive sensors.

The device guarantees high accuracy and a stable measure versus time and temperature. In order to ensure the safety plant, the device is equipped with a Watch-Dog Timer system. The Ethernet interface allows reading and writing in real time the values of the internal registers of the device.

The LEDs of signalling of Ethernet activity and power supply allow a direct monitoring of the system functionality.

The built-in Web Server allows the remote visualization, acquisition of the analogue inputs and the access to the main Ethernet programming parameters. The device is also configurable by the software Dev9K, a free IDE developed by DATEXEL.

The connection is made by removable screw-terminals (inputs and power supply) and RJ45 plug (Ethernet) .

The device realizes a full electrical isolation between the lines, introducing a valid protection against the effects of all ground loops eventually existing in industrial applications. The device is housed in a rough self-extinguishing plastic enclosure which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

To configure the device use the INIT modality (refer to the User Guide of the device). Connect power supply, Ethernet and analogue inputs as shown in the "Wiring" section. The LEDs state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

<p>In compliance with Ethernet IEEE 802.3</p>			<p>Input Accuracy (1) mA ±0.05 % f.s. Volt ±0.05 % f.s.</p>	<p>POWER SUPPLY Power supply voltage 20 .. 30 Vdc Reverse polarity protection 60 Vdc max Current Consumption 220 mA max</p>
<p>Network interface</p>	<p>Ethernet 10/100Base-T</p>			
<p>Protocol</p>	<p>Modbus TCP</p>		<p>Linearity (1) mA ±0.1 % f.s. Volt ±0.1 % f.s.</p>	<p>ISOLATION Power Supply / Ethernet 1500 Vac, 50 Hz, 1 min Inputs / Power supply 1500 Vac, 50 Hz, 1 min Inputs / Ethernet 1500 Vac, 50 Hz, 1 min Input / Input 1500 Vac, 50 Hz, 1 min</p>
<p>Max. cable length</p>	<p>100 meters</p>			
<p>Number of socket</p>	<p>16</p>		<p>Input Impedance Volt ≥ 1 MΩ mA ~ 22 Ω</p>	<p>ENVIRONMENTAL CONDITIONS Operative Temperature -10°C .. +60°C Storage Temperature -40°C .. +85°C Humidity (not condensed) 0 .. 90 % Maximum Altitude 2000 m Installation Indoor Category of installation II Pollution Degree 2</p>
<p>ANALOG INPUTS</p>				
<p>Input Type</p>	<p>Min</p>	<p>Max</p>	<p>Thermal drift (1) Full Scale ± 0.01 %/°C</p>	<p>CONNECTIONS Ethernet RJ-45 (on terminals side) Inputs/Power Supply Removable screw terminals</p>
<p>Current mA</p>	<p>-20 mA</p>	<p>+20 mA</p>		
<p>Voltage Volt</p>	<p>-10 V</p>	<p>+10 V</p>	<p>Auxiliary Supply (for each channel) 12 Vdc min @ 20 mA</p>	<p>MECHANICAL SPECIFICATIONS Material Self-extinguish plastic IP Code IP20 Wiring wires with diameter 0.8÷2.1 mm² /AWG 14-18 Tightening Torque 0.5 N m Mounting in compliance with DIN rail standard EN-50022 Weight about 160g</p>
<p>Short Circuit Current Auxiliary Supply 28 mA</p>				
<p>Sampling time (4 channels) 150 ms</p>			<p>EMC (for industrial environments) Immunity EN 61000-6-2 Emission EN 61000-6-4</p>	
<p>(1) Referred to input Span (difference between max. and min. values)</p>				
<p>(**) 4 Operative Auxiliary Supply @20mA</p>				

INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it is necessary to separate them by at least 5 mm

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.


MAPPING MODBUS REGISTERS

Register Position	Description	Access	
40002	Firmware [0]	RO	
40003	Firmware [1]	RO	
40004	Name [0]	R/W	
40005	Name [1]	R/W	
40007	Node ID	R/W	
40011	System Flags	R/W	
40013	Watchdog timer	R/W	
40031	Input type Channels 0 (1-0)	R/W	
40032	Input type Channels 1 (3-2)	R/W	
40033	Input type Channels 2 (5-4)	R/W	
40034	Input type Channels 3 (7-6)	R/W	
40041	Analogue Input (0) - mA	RO	CH0
40042	Analogue Input (1) - V	RO	
40043	Analogue Input (2) - mA	RO	CH1
40044	Analogue Input (3) - V	RO	
40045	Analogue Input (4) - mA	RO	CH2
40046	Analogue Input (5) - V	RO	
40047	Analogue Input (6) - mA	RO	CH3
40048	Analogue Input (7) - V	RO	

LIGHT SIGNALLING


LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
		BLINK	Watchdog alarm
STS	YELLOW	OFF	Device in RUN modality
		BLINK	Device in INIT modality

MECHANICAL DIMENSIONS (mm)

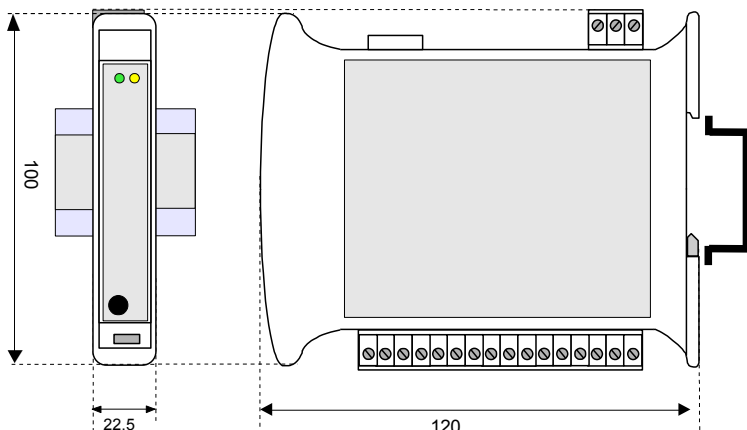


CONNECTIONS

POWER SUPPLY

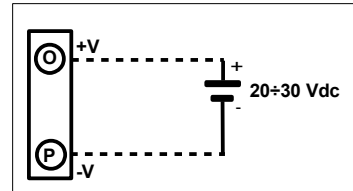


INIT

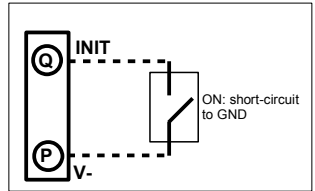


ANALOGUE INPUTS


VOLTAGE

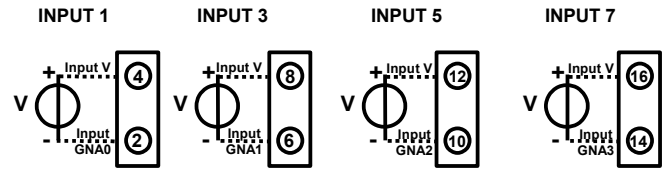

PASSIVE mA INPUT

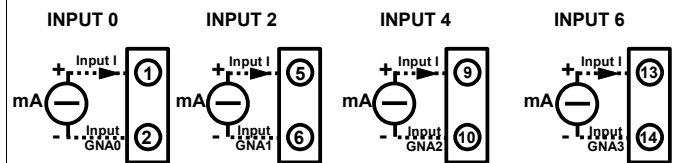

ACTIVE mA INPUT

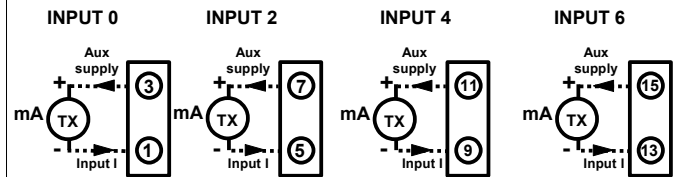


NOTES:

"GNA0", "GNA1", "GNA2" and "GNA3" are isolated between them.

Input Voltage 1 and Input current 0 belong to channel 0 (CH0)
 Input Voltage 3 and Input current 2 belong to channel 1 (CH1)
 Input Voltage 5 and Input current 4 belong to channel 2 (CH2)
 Input Voltage 7 and Input current 6 belong to channel 3 (CH3)

ISOLATIONS STRUCTURE

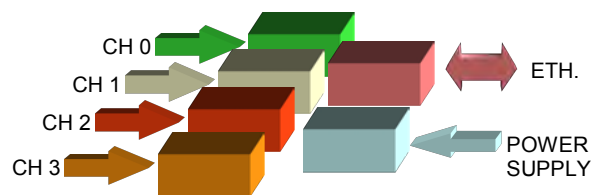

HOW TO ORDER

" DAT 8015 "

Note: the device is provided with default configuration as:
 IP address : 192.168.1.100
 Modbus address: 1



The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste. For more information contact the proper office in the user's city, the service for the waste treatment or the supplier from which the product has been purchased.