

GENERAL DESCRIPTION

The device DAT8014 is a Modbus TCP server unit that can convert up to 4 analogue signals applied to the input in engineering units in digital format. The inputs can be connected to two or three wires RTD or resistance sensors.

The input channels are electrically isolated from each other.

The device guarantees high accuracy and a stable measure versus time and temperature. In order to ensure the safety plant, the device is equipped with a Watch-Dog Timer system. The Ethernet interface allows reading and writing in real time the values of the internal registers of the device.

The LEDs of signalling of Ethernet activity and power supply allow a direct monitoring of the system functionality.

The built-in Web Server allows the remote visualization, acquisition of the analogue inputs and the access to the main Ethernet programming parameters. The device is also configurable by the software *Dev9K*, a free IDE developed by DATEXEL.

The connection is made by removable screw-terminals (inputs and power supply) and RJ45 plug (Ethernet).

The device realizes a full electrical isolation between the lines, introducing a valid protection against the effects of all ground loops eventually existing in industrial applications. The device is housed in a rough self-extinguishing plastic enclosure which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

To configure the device use the INIT modality (refer to the User Guide of the device). Connect power supply, Ethernet and analogue inputs as shown in the "Wiring" section. The LEDs state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

In compliance with Ethernet IEEE 802.3			Input Accuracy (1)		POWER SUPPLY		
Network interface Ethernet 10/100Base-T Protocol Modbus TCP		RTD Resistance Potentiometer	±0.05 % f.s. ±0.05 % f.s. ±0.05 % f.s.	Power supply voltage Reverse polarity protection Current Consumption	14 30 Vdc 60 Vdc max 115 mA max		
Number of socket			Linearity (1) RTD	±0.1 % f.s.	ISOLATION Power Supply / Ethernet Inputs / Power supply	1500 Vac, 50 Hz, 1 min 1500 Vac, 50 Hz, 1 min	
			Lead wire resistance influence (1)		Inputs / Ethernet Input / Input	1500 Vac, 50 Hz, 1 min 1500 Vac, 50 Hz, 1 min	
Input Type	Min	Max	RTD/res.3 wires (50 Ω max balance	d) 0.05% f.s./Ω	ENVIRONMENTAL CONDITIONS		
RTD 2 or 3 wires Pt100 Pt1000 Ni100 Ni1000	-200 °C -200 °C -60 °C -60 °C	850 °C 200 °C 180 °C 150 °C	RTD excitation current Typical Thermal drift (1)	0.370 mA	Operative Temperature Storage Temperature Humidity (not condensed) Maximum Altitude Installation	-10°C +60°C -40°C +85°C 0 90 % 2000 m Indoor	
RES 2 or 3 wires			Full Scale	± 0.01 %/°C	Category of installation Pollution Degree	 2	
Low High	0Ω 0Ω	500 Ω 2000 Ω	Sampling time (4 channels)	150 ms		2	
POT. (nom. value)	20 Ω	50 kΩ	Warm-up time	3 min	Ethernet Inputs/Power Supply	RJ-45 (on terminals side) Removable screw terminals	
					MECHANICAL SPECIFICAT Material IP Code Wiring Tightening Torque Mounting Weight	Self-extinguish plastic IP20 wires with diameter 0.8+2.1 mm ² /AWG 14-18 0.5 N m in compliance with DIN rail standard EN-50022 about 160g	
					EMC (for industrial enviror Immunity Emission	ments) EN 61000-6-2 EN 61000-6-4	
(1) Referred to input Span (difference between max. and min. values)							

INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it is necessary to separate them by at least 5 mm

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.

MAPPING MODBUS REGISTERS


Register Position	Description	Access
40002	Firmware [0]	RO
40003	Firmware [1]	RO
40004	Name [0]	R/W
40005	Name [1]	R/W
40007	Node ID	R/W
40011	System Flags	R/W
40013	Watchdog timer	R/W
40031	Input type Channel 0	R/W
40032	Input type Channel 1	R/W
40033	Input type Channel 2	R/W
40034	Input type Channel 3	R/W
40041	Analogue Input (0) - Ch0	RO
40042	Analogue Input (1) - Ch1	RO
40043	Analogue Input (2) - Ch2	RO
40044	Analogue Input (3) – Ch3	RO
40050	Break status	RO


LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON Device powered	
		OFF	Device not powered
		BLINK	Watchdog alarm
STS	YELLOW	OFF	Device in RUN modality
		BLINK	Device in INIT modality

POWER SUPPLY

CONNECTIONS



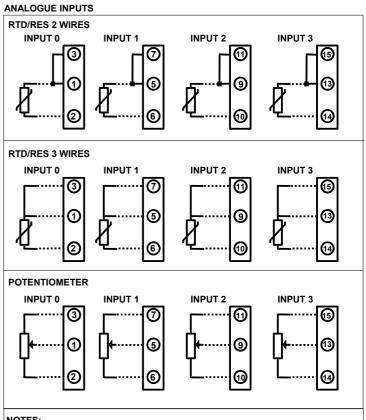

NOTES

All input channels are isolated between them.

ISOLATIONS STRUCTURE



